


**RECHARGE NOTES:**

1. STRIP ALL TOPSOIL, SUBSOIL AND UNSUITABLE MATERIAL, FILL, TREE ROOTS AND STUMPS AND ANY OTHER IMPERVIOUS OR SPECIFIED SOIL IN THE AREA OF THE SYSTEM AND 2 FEET BEYOND HORIZONTALLY IN ALL DIRECTIONS, WHERE POSSIBLE. STRIP MATERIAL VERTICALLY 3" MINIMUM INTO PERMEABLE NATIVE SOIL. REPALCE WITH GRANULAR FILL MEETING THE LATEST SPECIFICATIONS OF 310 CMR 15.255. (MA. TITLE 5)
2. CHAMBERS ARE TO BE INSTALLED AS PER MANUFACTURER'S INSTRUCTIONS.
3. IF CONDITIONS ENCOUNTERED DURING CONSTRUCTION VARY SUBSTANTIALLY FROM THOSE SHOWN ON THIS PLAN, NOTIFY CAPUTO AND WICK, LTD. BEFORE PROCEEDING WITH CONSTRUCTION.
4. ALL STONE USED FOR CONSTRUCTION OF THE SYSTEM MUST BE DOUBLE WASHED AS SPECIFIED BY 310 CMR 15.247. ACTUAL STONE MATERIAL MAY ALSO BE SUBJECT TO APPROVAL BY THE ENGINEER.
5. MATERIAL AND EQUIPMENT FROM ALTERNATE MANUFACTURERS MAY BE USED IF EQUAL. APPROVAL FOR ALTERNATE MATERIAL AND/OR EQUIPMENT REQUIRED FROM ENGINEER PRIOR TO CONSTRUCTION. FULL SPECIFICATIONS FOR ALTERNATE EQUIPMENT MUST BE PROVIDED BY CONTRACTOR.
6. THE DESIGNER EXPRESSLY DISCLAIMS ANY RESPONSIBILITY FOR MONITORING, INSPECTING OR SUPERVISING THE ACTUAL CONSTRUCTION WORK. THE DESIGNER EXPRESSLY DISCLAIMS ANY RESPONSIBILITY, FOR THE INSTALLATION AND MAINTENANCE OF THE SYSTEM.
7. FILL MEETING THE REQUIREMENTS OF 310 CMR 15.255(3) MUST BE PLACED ON SCARIFIED, RELATIVELY DRY NATIVE SOIL. THE CONTRACTOR SHALL PROVIDE FOR DEWATERING AS REQUIRED AND ALL WORK SHALL BE PERFORMED UNDER DRY CONDITIONS. IF DEWATERING IS NECESSARY DISCHARGE WATER MUST BE FILTERED THROUGH A "DANDY DEWATERING BAG", OR EQUAL.
8. SOIL DATA FROM PLAN ENTITLED "SEWAGE DISPOSAL REPAIR PLAN, MAP 31, LOT 474, 475 - NO. 48 CASE AVENUE - SEEKONK, MASSACHUSETTS" BY GORDON WOLFE, RS. DATED MAY 2002.

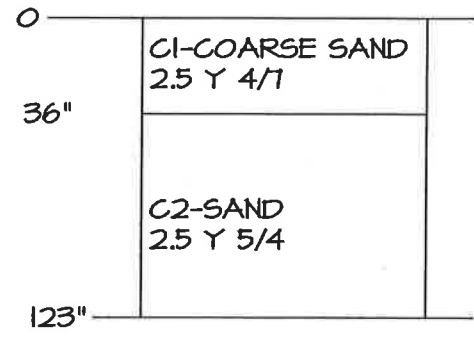

PERC. RATE: <2 M.P.I.  
 PERC. DEPTH: 39"  
 DATE: 7/25/2001  
 WATER DEPTH: DRY @ 123"  
 WITNESS: MR. CHENEVERT  
 PERFORMED BY: GORDON WOLF

**ROOF RECHARGE STRUCTURE DETAILS**  
 SCALE 1/4" = 1'-0"