


**SOIL LOG**


10' R 1/2	48.5
10' A SL	47.7
10' B L S	46.3
2' C	45.0
42" NOTILES	43.0
6.6" SAND	
7.5' R 1/2	
120" DRY	6.28-07 38.5

- NOTES:**
1. DESIGN PERCOLATION RATE = 2 MINUTES PER INCH.
  2. DESIGN FLOW = 330 G.P.D.
  3. REQUIRED LEACHING AREA = 330 x 1.351 = 446 S.F.
  4. USE BED SIZE 20" x 23" = 460 S.F.
  5. ALL UNSUITABLE MATERIAL IS TO BE REMOVED FROM UNDER THE BED AND TO 5 FEET BEYOND AND REPLACED WITH SAND COMPACTING TO 310 CMR 15.255(3).
  6. NOT DESIGNED FOR USE OF GARAGE GRINDER.
  7. ALL PIPE 4 INCH SCHEDULE 40 EXCEPT AS NOTED.
  8. PERCOLATION TEST PERFORMED BY EDWARD KINGMAN AND WITNESSED BY J.R. 6-28-07
  9. EXISTING CESSPOOLS TO BE FILLED WITH SAND AND ABANDONED.
  10. WASHER AND ALL PLUMBING FIXTURES ARE TO BE CONNECTED TO THE MAIN SEWER.
  11. REVERSE PLUMBING TO EXIT AT THE INVERT AND LOCATION SHOWN.
  12. A VARIANCE IS REQUIRED FOR FOUR FOOT CLEARANCE ABOVE ESTIMATED SEASONAL HIGH GROUND WATER.
  13. APPLY MAGNETIC TAPE TO ALL COMPONENTS.

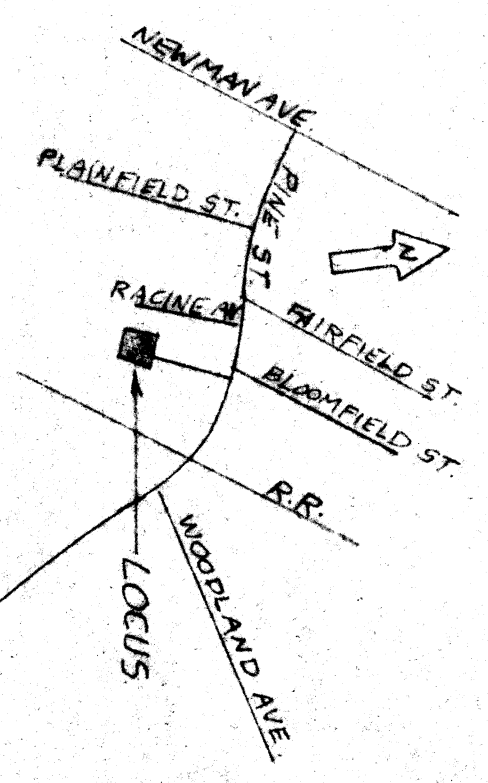

LOCUS MAP  
RDA  
137 DINGSF.

Received  
JUL 17 2007  
Con. Comm.

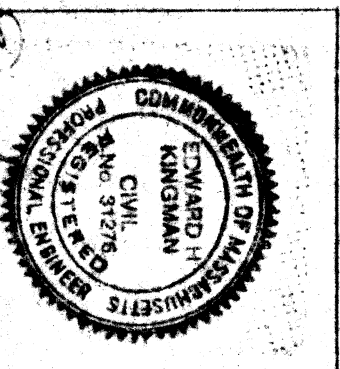

**REPAIR SEPTIC SYSTEM**

137 PINE STREET  
SEEKONK  
MASSACHUSETTS

DATE: 7-16-07  
DRAWN BY: [Signature]  
REVISION: [Signature]

PREPARED FOR:  
GEORGE & BEATRICE JETTE

DRAWING NUMBER: [Blank]