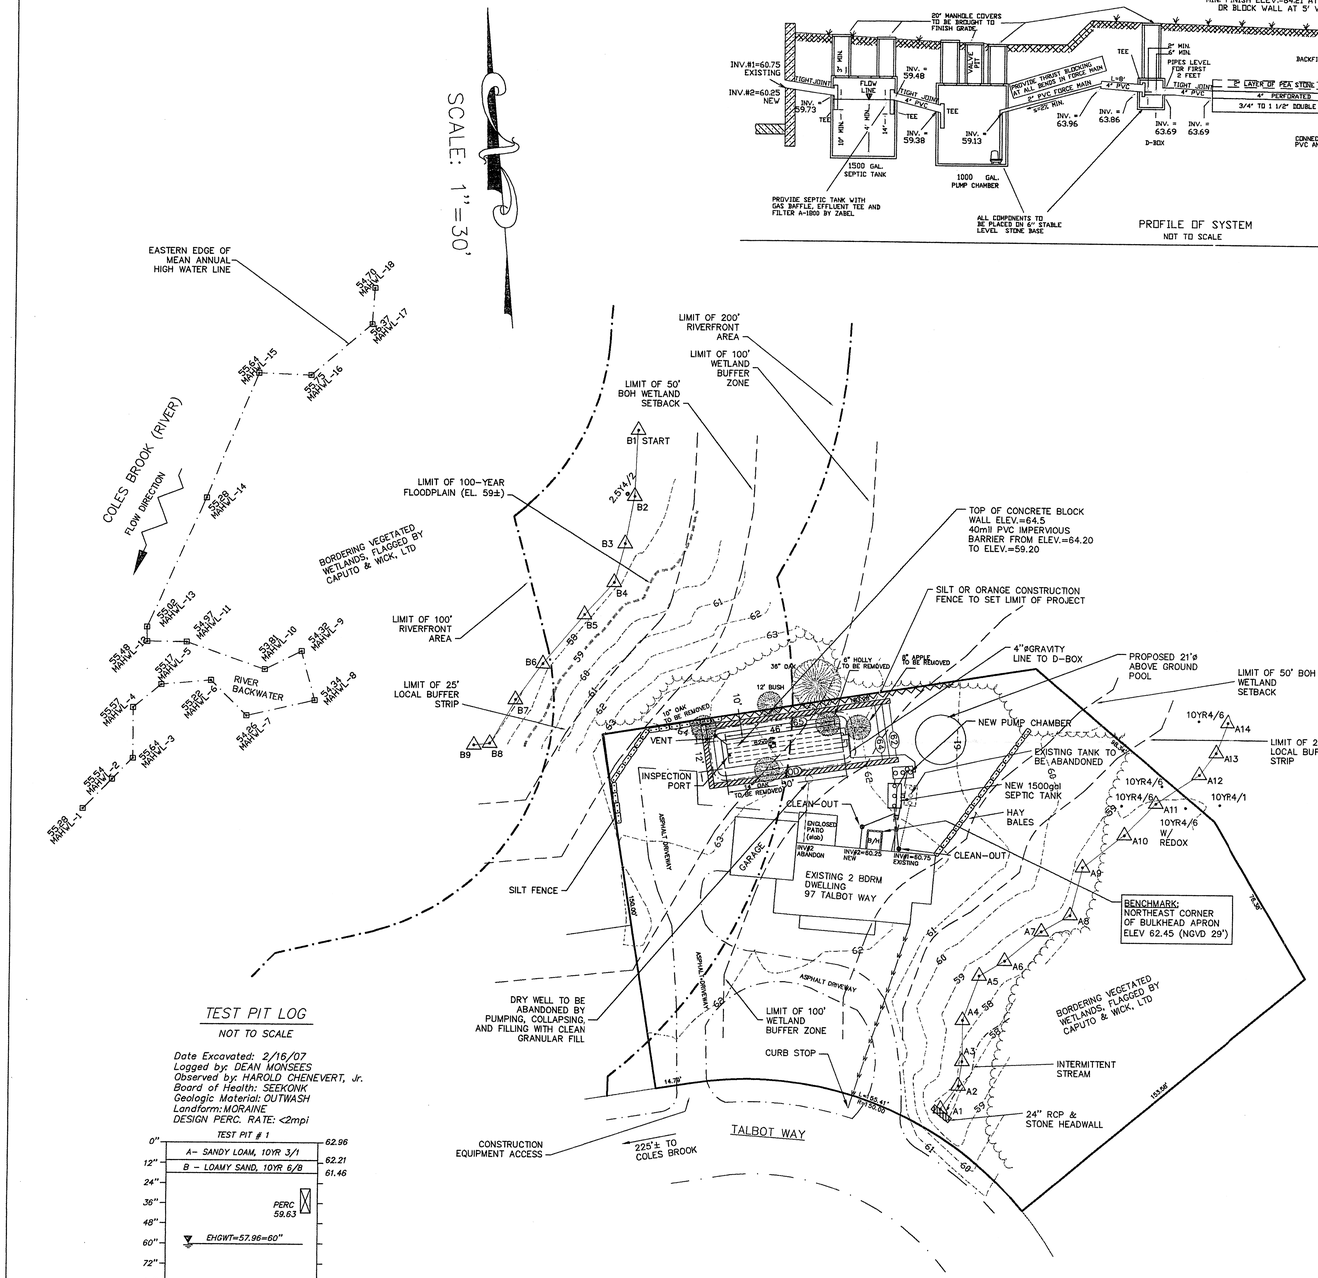

PROFILE OF SYSTEM
NOT TO SCALE

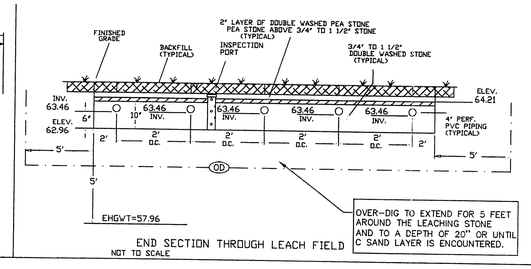

END SECTION THROUGH LEACH FIELD
NOT TO SCALE

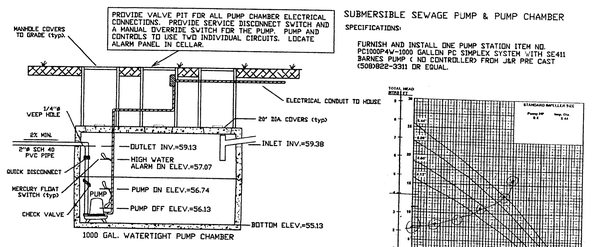

CROSS SECTION OF PUMP CHAMBER
NTS

SUBMERSIBLE SEWAGE PUMP & PUMP CHAMBER SPECIFICATIONS:

FURNISH AND INSTALL ONE PUMP STATION ITEM NO. PC200SP4W-1000 GALLON PC SIMPLEX SYSTEM WITH SE411 BARNES PUMP (NO CONTROLLER) FROM J&R PRE CAST (508)822-3311 OR EQUAL.



LOCUS:

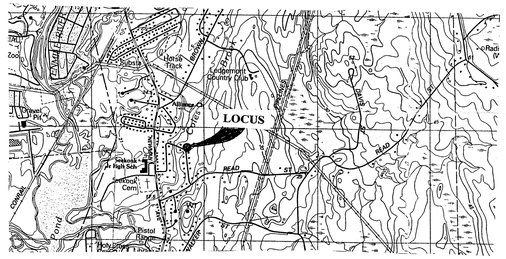
LOCUS
Horse Track
Condominium Driving Range
Cemetery
Sewage Treatment Plant
Sewage Lagoons
Municipal Golf Course
Seekonk Water Dept
Bullocks Corner
Pistol Range
Pond
Tidy Brook
Tidy Brook Farm
Seekonk Municipal Golf Course
Seekonk Municipal Golf Course
Seekonk Municipal Golf Course