

TEST PIT 1		TEST PIT 2	
0	33.2	0	33.5
1.9'	TOP and SUBSOIL 23"	2.3'	TOP and SUBSOIL 28"
	H ₂ O @ 2'2" EL: 91.0		H ₂ O @ 2'6" EL: 91.0
9.9'	FINE MED SAND, GRAVEL SMALL ROCKS SILTY	10.3'	FINE-MED SAND, GRAVEL SMALL ROCKS SILTY
	76'		76'

WATER TABLE DATA

DATE DUG: 9/12/93
DATE READ: 1/31/94
W.T. DEPTH: T.P. 1 26", T.P. 2 30", T.P. 3 28"
PERC RATE: 13 M.P.I.
PERC DEPTH 40"
WITNESS HAROLD CHENEVERT
PERFORMED BY: R HAWLEY





- NOTES**
- ALL WORK SHALL CONFORM TO THE 310 CMR 15.00 STATE ENVIRONMENTAL CODE TITLE 5 RULES AND REGULATIONS AND THE RULES AND REGULATIONS OF THE LOCAL BOARD OF HEALTH.
 - STRIP ALL TOP SOIL, SUB SOIL AND ANY OTHER IMPERVIOUS SOIL IN THE AREA OF THE SYSTEM AND 25 FEET BEYOND IN ALL DIRECTIONS WHERE POSSIBLE. REPLACE WITH GRAVEL.
 - ALL PIPING TO BE 4" P.V.C. SCH. 40 UNLESS OTHERWISE NOTED.
 - THE CELLAR FLOOR ELEVATION SHOWN HAS BEEN SUGGESTED AS A MINIMUM BASED UPON OBSERVED GROUNDWATER CONDITIONS. SINCE GROUNDWATER LEVELS FLUCTUATE ANNUALLY, NO WARRANTY OF A DRY CELLAR IS EXPRESSED OR IMPLIED.
 - IF CONDITIONS ENCOUNTERED DURING CONSTRUCTION VARY SUBSTANTIALLY FROM THOSE SHOWN ON THIS PLAN, NOTIFY CAPUTO AND WICK LTD. BEFORE PROCEEDING WITH CONSTRUCTION.

DESIGN DATA

DAILY SEWAGE FLOW
4 BEDROOMS x 110 G.P.D. x 150% = 660 G.P.D.

SEPTIC TANK REQUIREMENTS
1. USE 1,500 GALLON SEPTIC TANK
2. SHOULD BE CLEANED AT LEAST ANNUALLY

LEACHING AREA REQUIREMENTS
USE BED 24' x 65'
24' x 65' x 0.43' = 671 G.P.D.

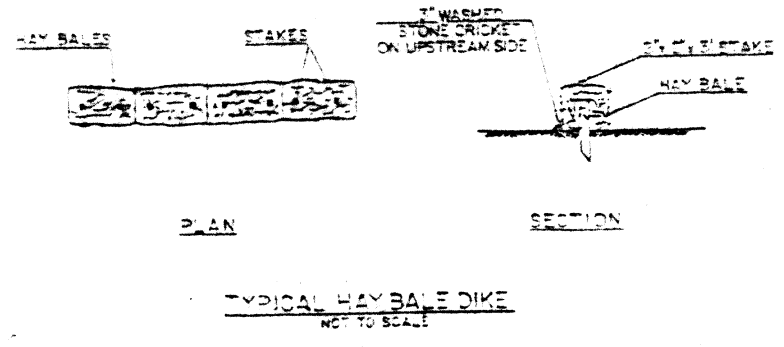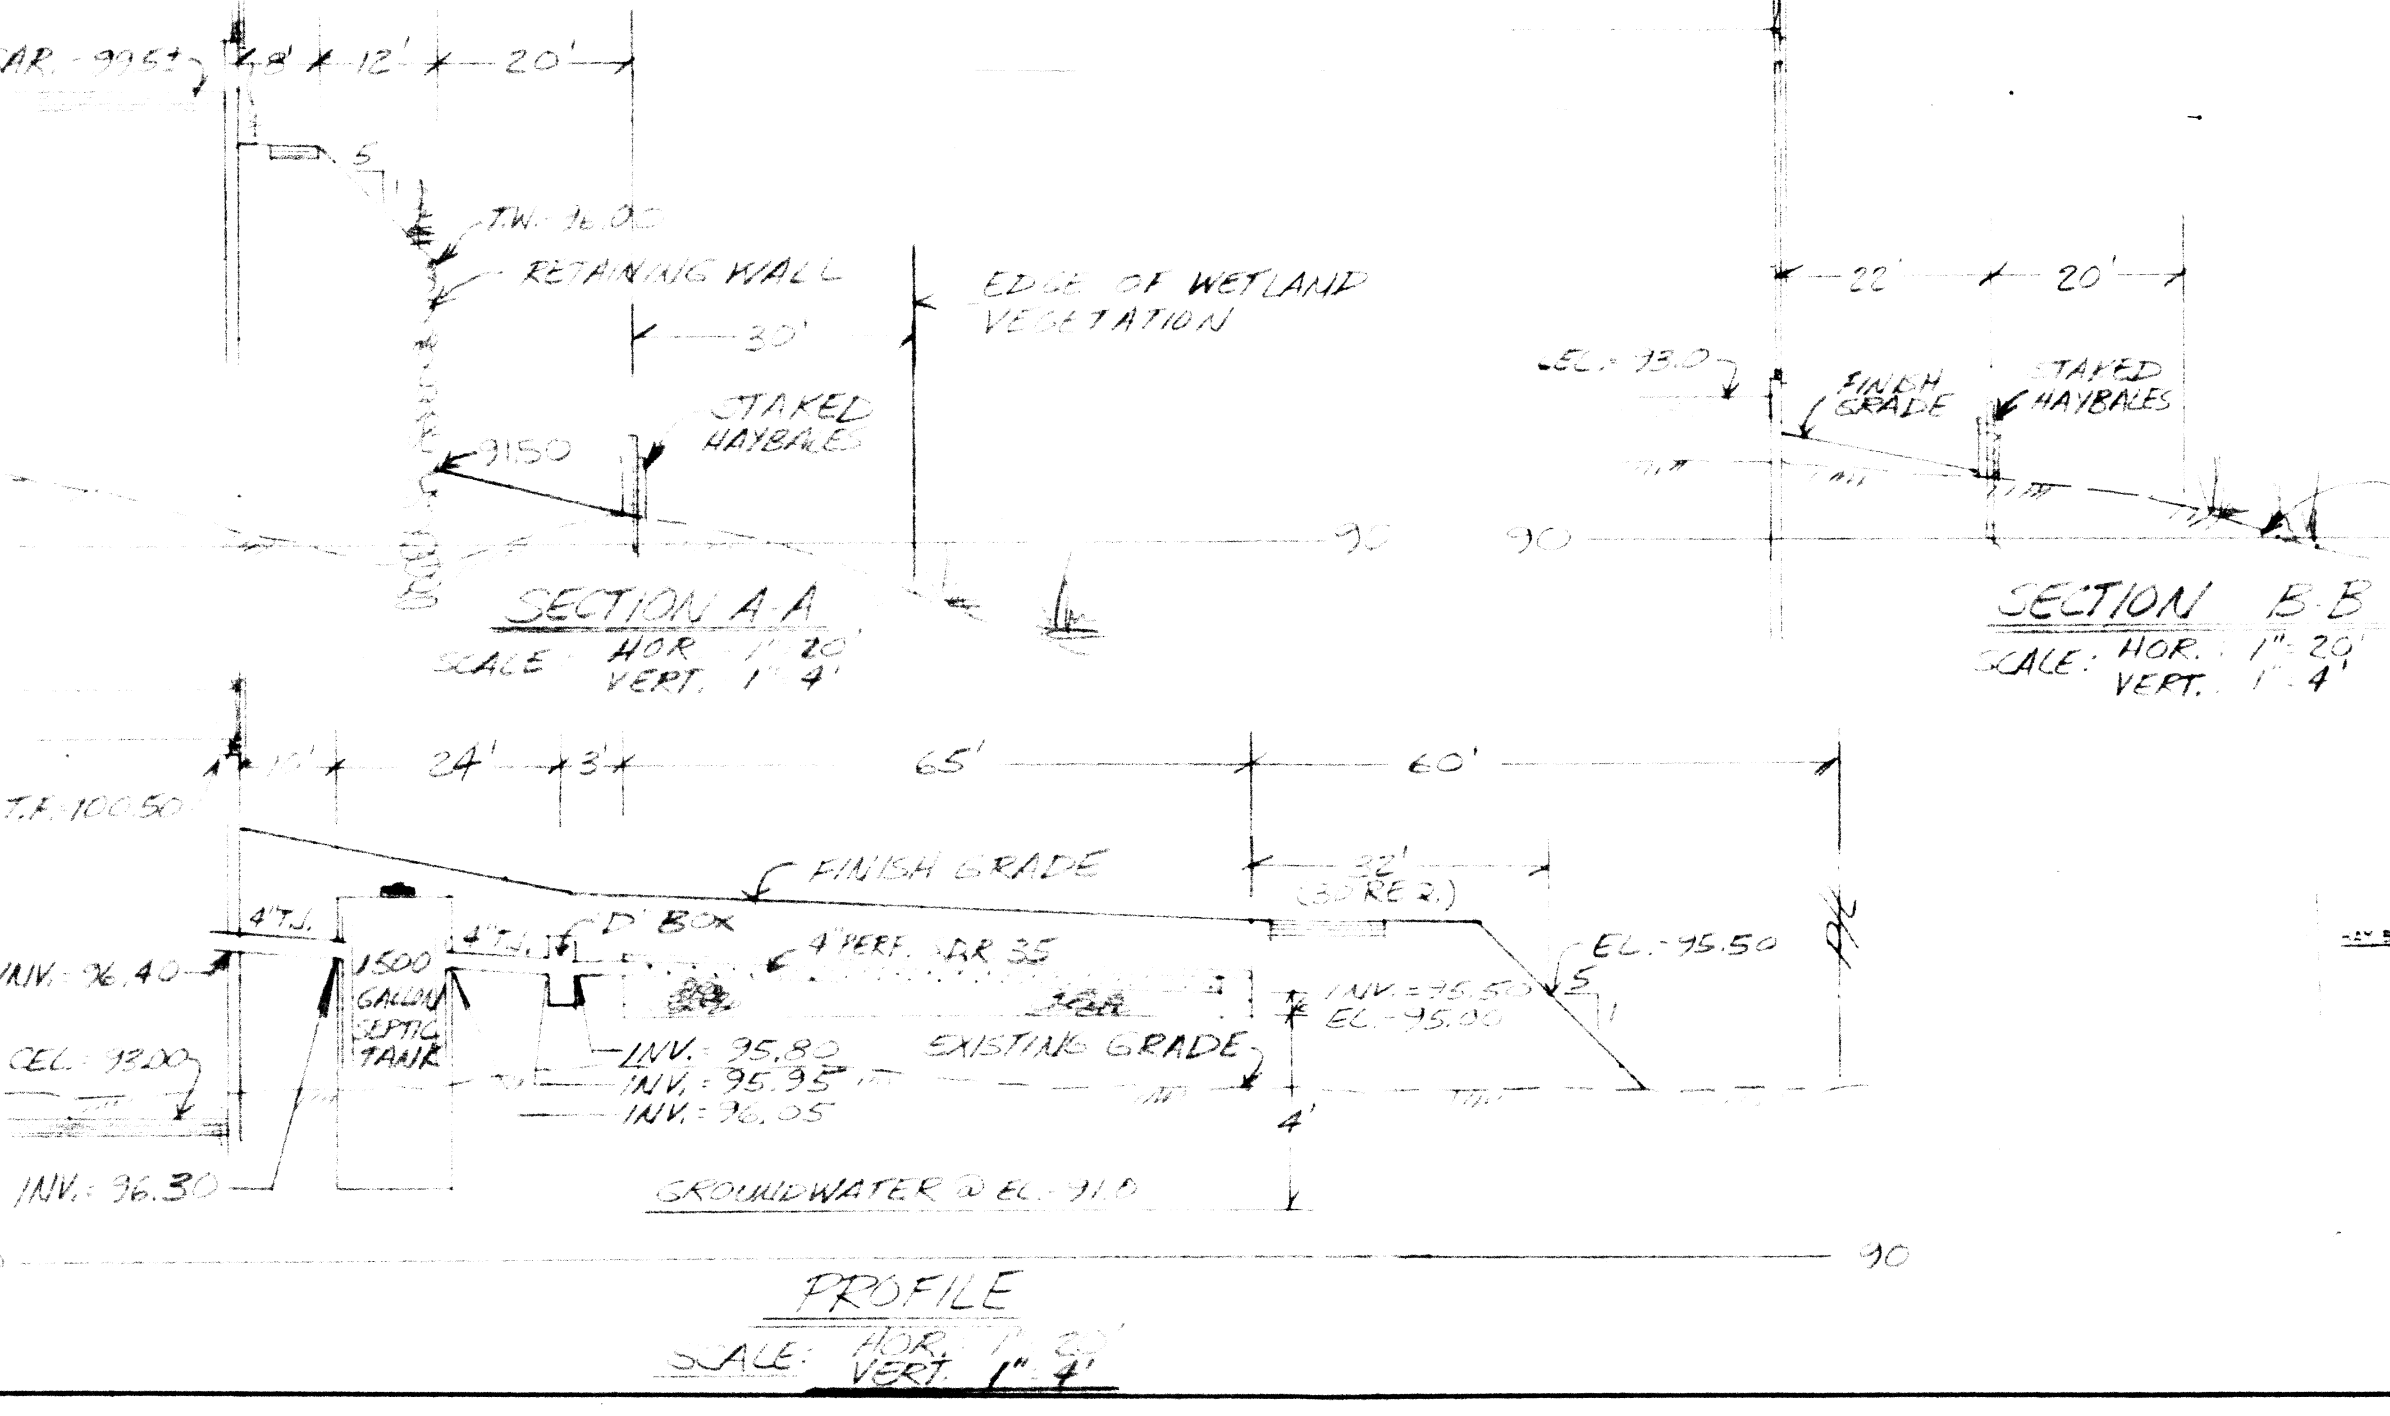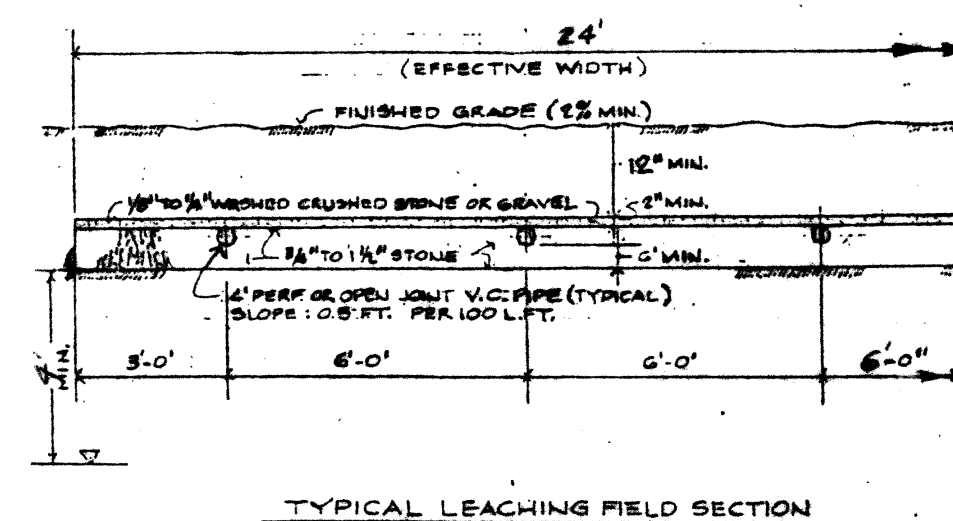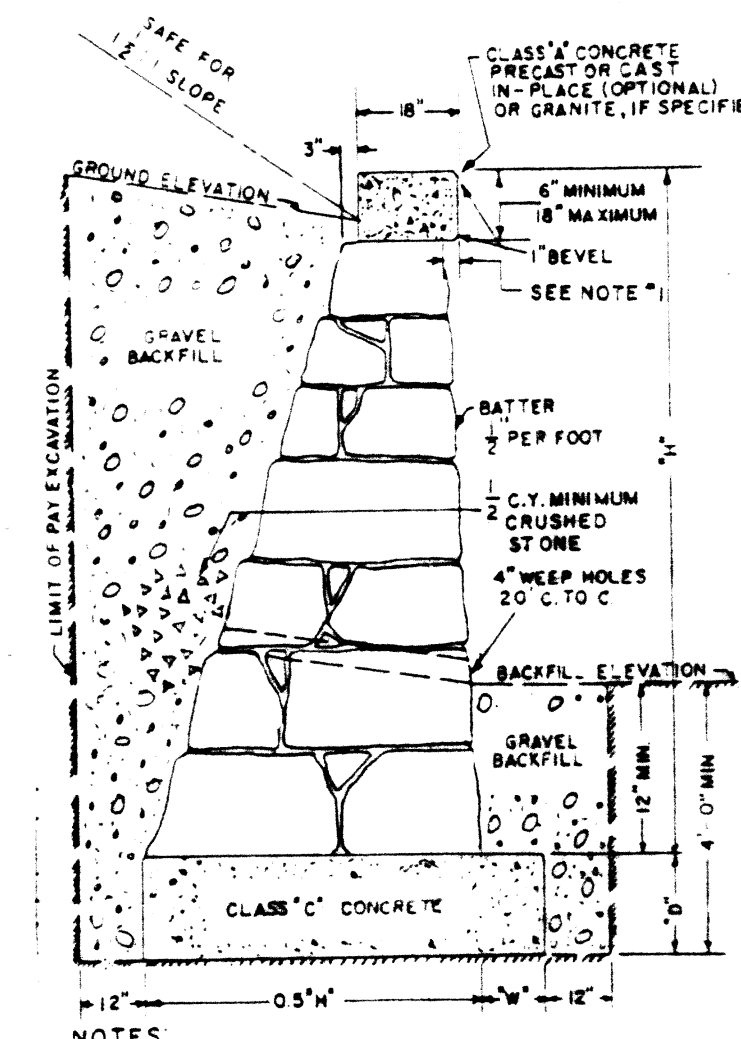

PLAT 6 LOT 379 ZONE: R-2 AREA: 3.52 ACRES

SITE PLAN
JORGE and EMILIA MARQUES
COUNTY STREET
SEEKONK, MASSACHUSETTS

ROONEY W WICK
No 87837

CAPUTO AND WICK LTD.
1150 PAWTUCKET AVE.
RUMFORD, R.I. 02916
401-434-8880

DATE: 2/17/95
SHEET: 1 OF 1