


WOODWARD

AVENUE

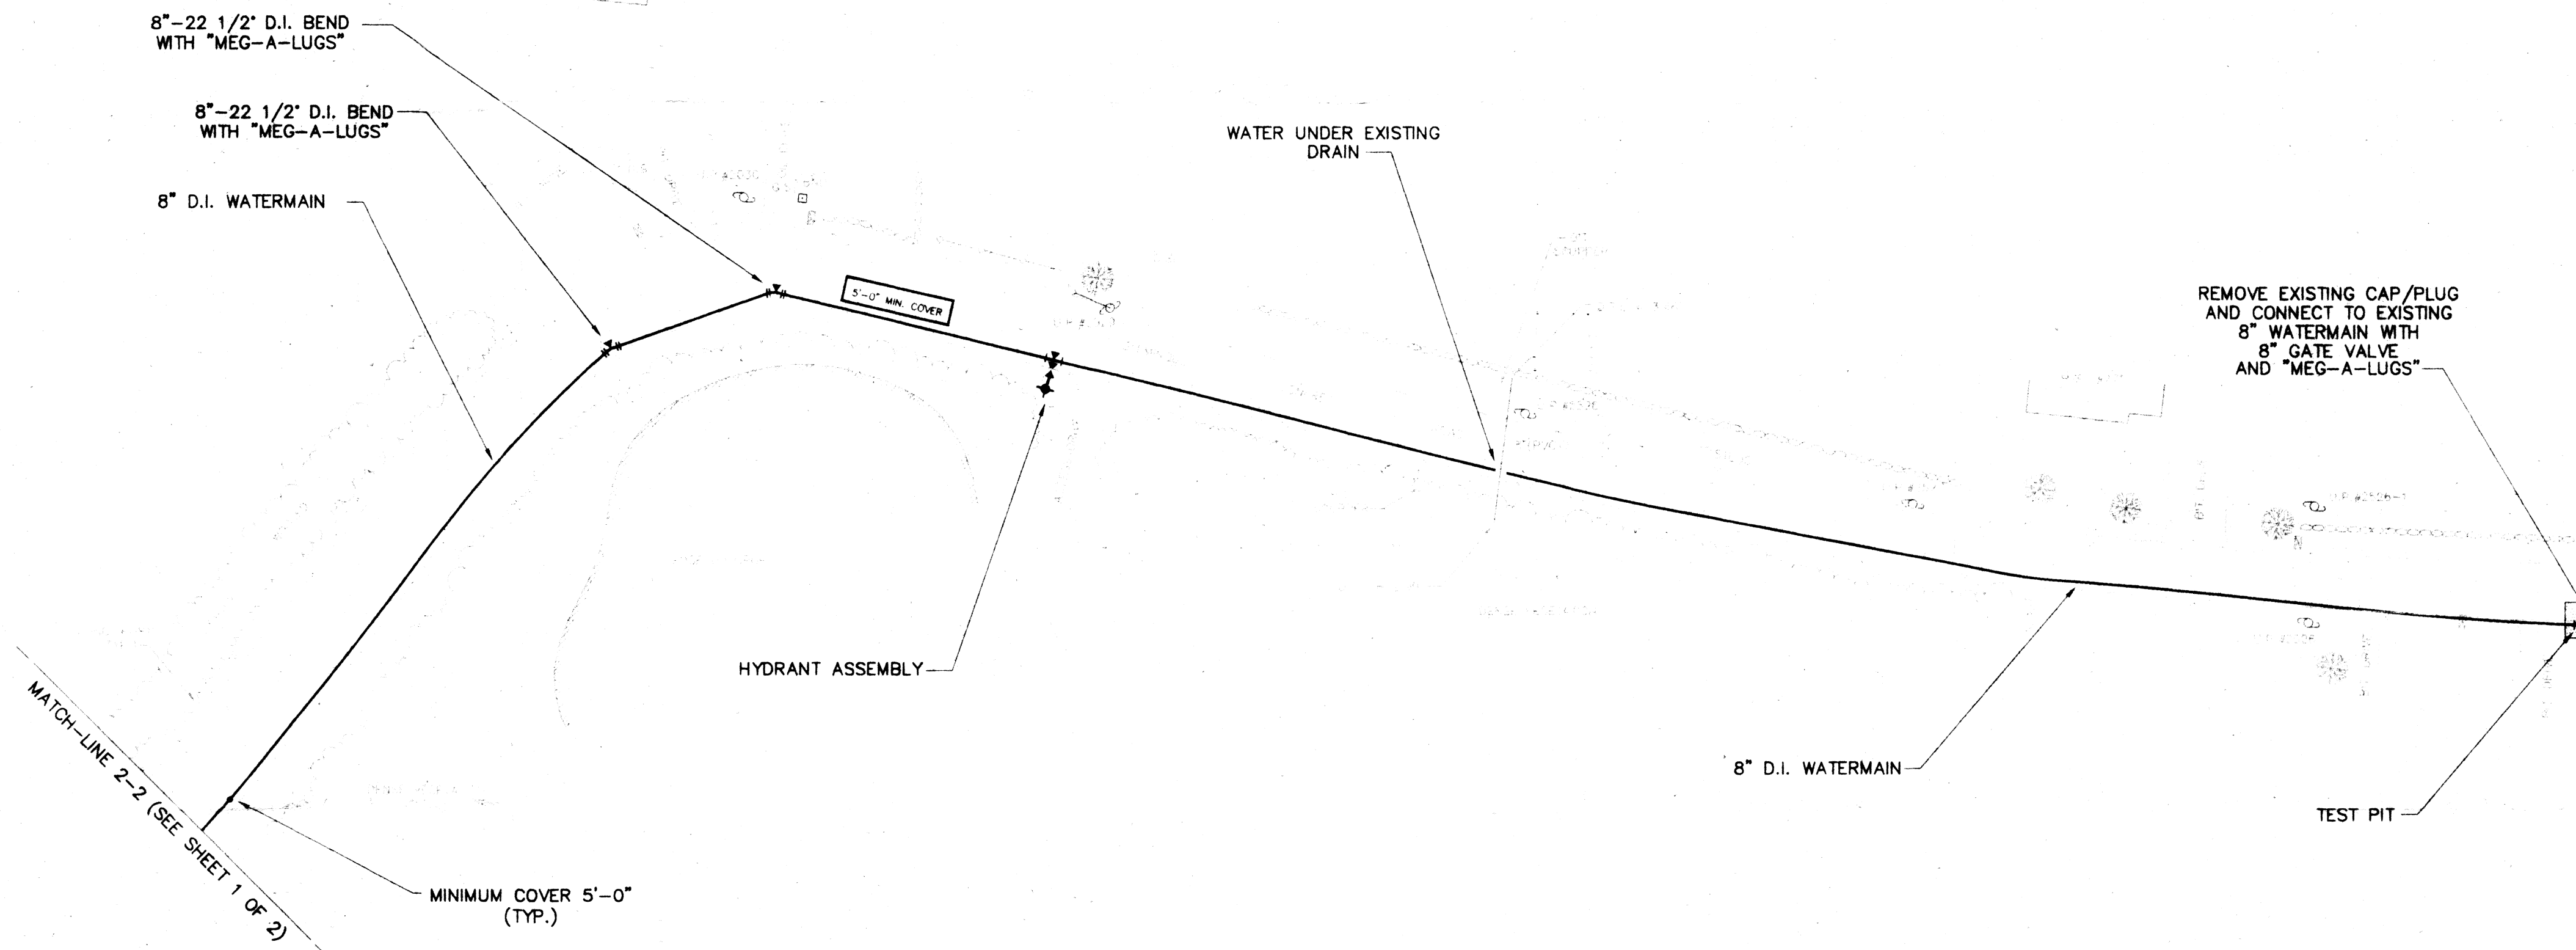


**PLAN**

SCALE 1" = 40'-0"

**LEGEND**

PROPOSED	EXISTING
8" DUCTILE-IRON WATERMAIN	16" CAST-IRON WATERMAIN
GATE VALVE	2" STEEL GAS MAIN
FITTING WITH CONCRETE THRUST BLOCK	12" REINFORCED CONCRETE DRAIN PIPE
HYDRANT ASSEMBLY	8" POLYVINYL CHLORIDE DRAIN PIPE
TEST PIT	DEPTH TO INVERT = 6.25' RELATIVE TO EDGE OF ROAD
RESTRAINED JOINT	DEPTH TO INVERT = 5.25' FROM TOP OF RIM
SILTATION FENCING	WATER SERVICE / GAS SERVICE
SEDIMENTATION CONTROL AT CATCH BASIN	WATER GATE / GAS GATE
5'-0" MIN. COVER	HYDRANT ASSEMBLY
	CATCH BASIN
	WETLANDS
	WATERBODY
	EDGE OF WOODS
	UTILITY POLE
	MAILBOX
	STONE OR GRANITE BOUND
	STONEWALL

PROVIDE POLYETHYLENE ENCASEMENT AROUND WATERMAIN AND TRANSITION COVER OVER WATERMAIN FROM 3.75' @ DRAIN CENTERLINE TO 5.0' OVER 40'-FT.

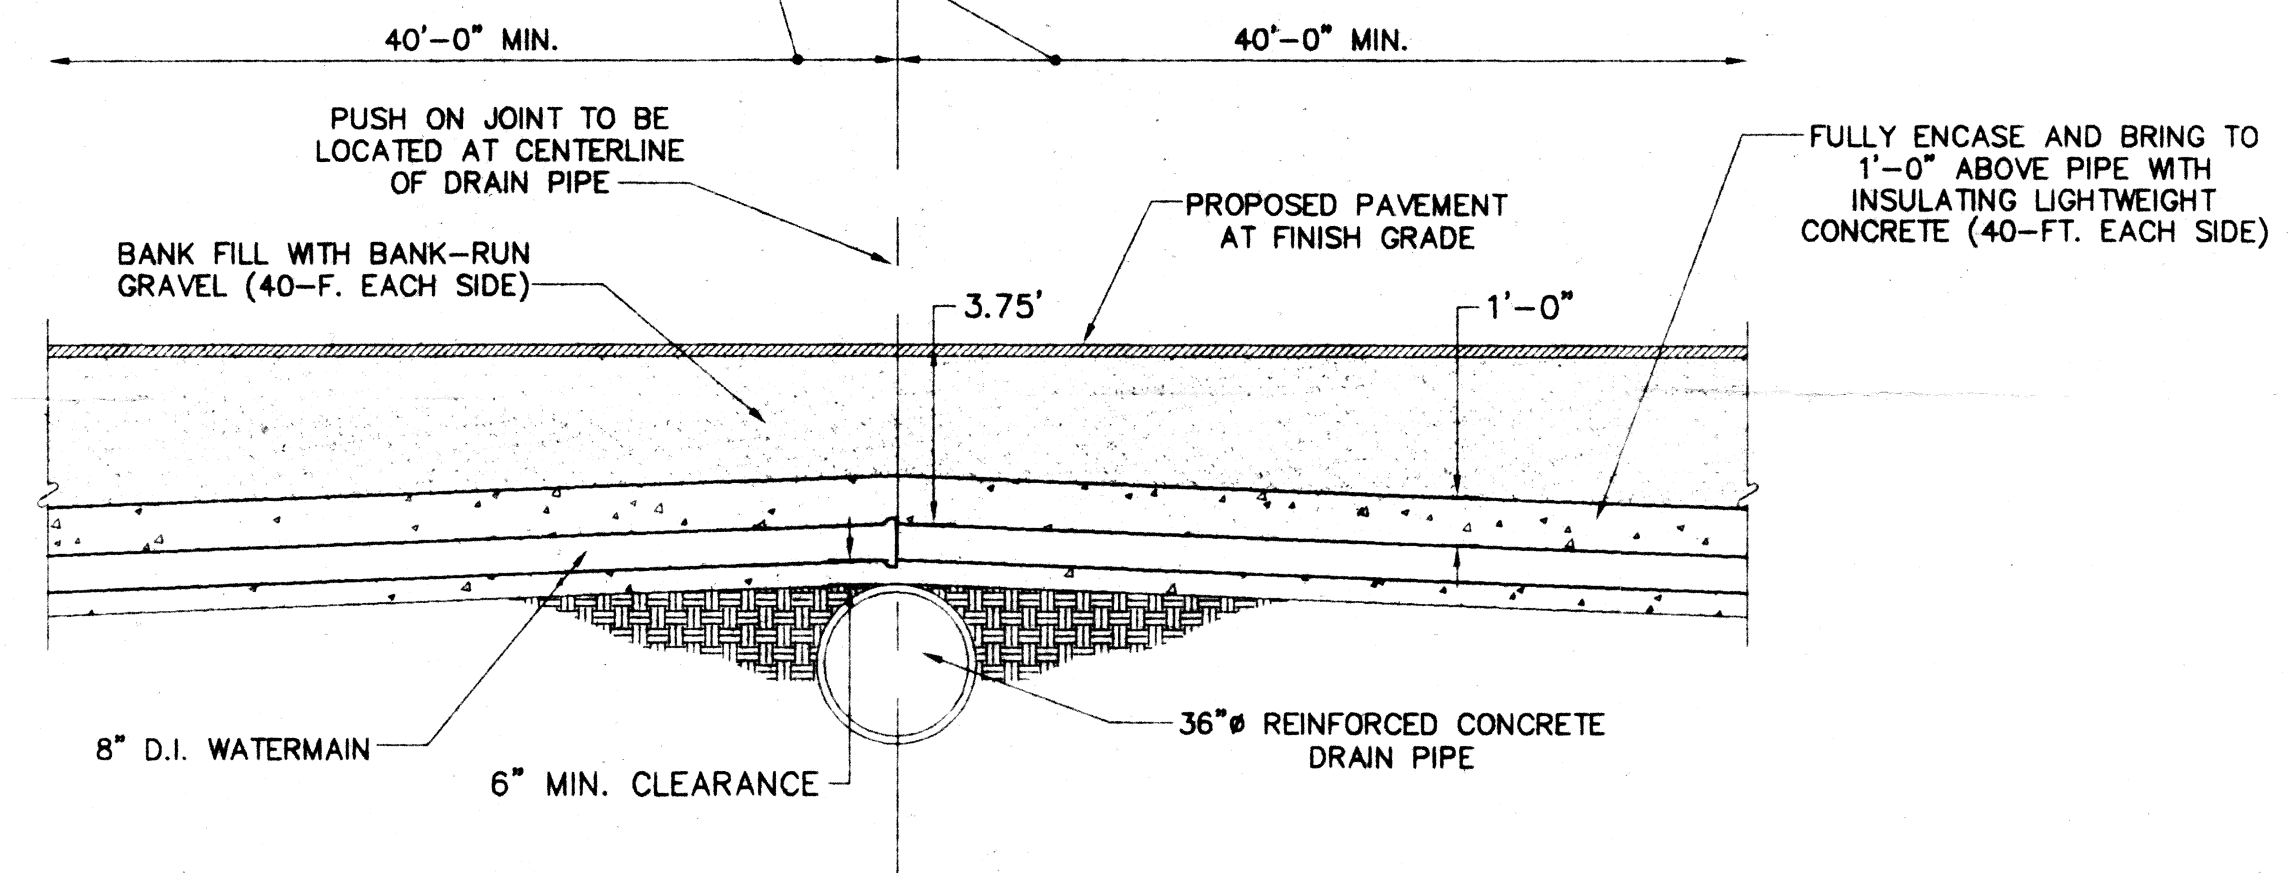

**PROFILE - DRAIN CROSSING**

SCALE 1/4" = 1'-0"

REVISIONS			AMORY ENGINEERS, P.C.			SEEKONK WATER DISTRICT SEEKONK, MASSACHUSETTS		CIVIL
NO.	ITEM	DATE	FILE NAME	JOB NO.	SCALE	CONSTRUCTION OF WATERMANS AND APPURTENANT WORK		SHEET
			SHEET2.DWG <td>2088 <td>1" = 40'-0" <td colspan="2">PLANS - 2</td> <td>2 OF 2</td> </td></td>	2088 <td>1" = 40'-0" <td colspan="2">PLANS - 2</td> <td>2 OF 2</td> </td>	1" = 40'-0" <td colspan="2">PLANS - 2</td> <td>2 OF 2</td>	PLANS - 2		2 OF 2
				1/4/99	DWG NO.: 935	WOODWARD AVENUE		
					CONTRACT: 1999-W2			