


AVE.

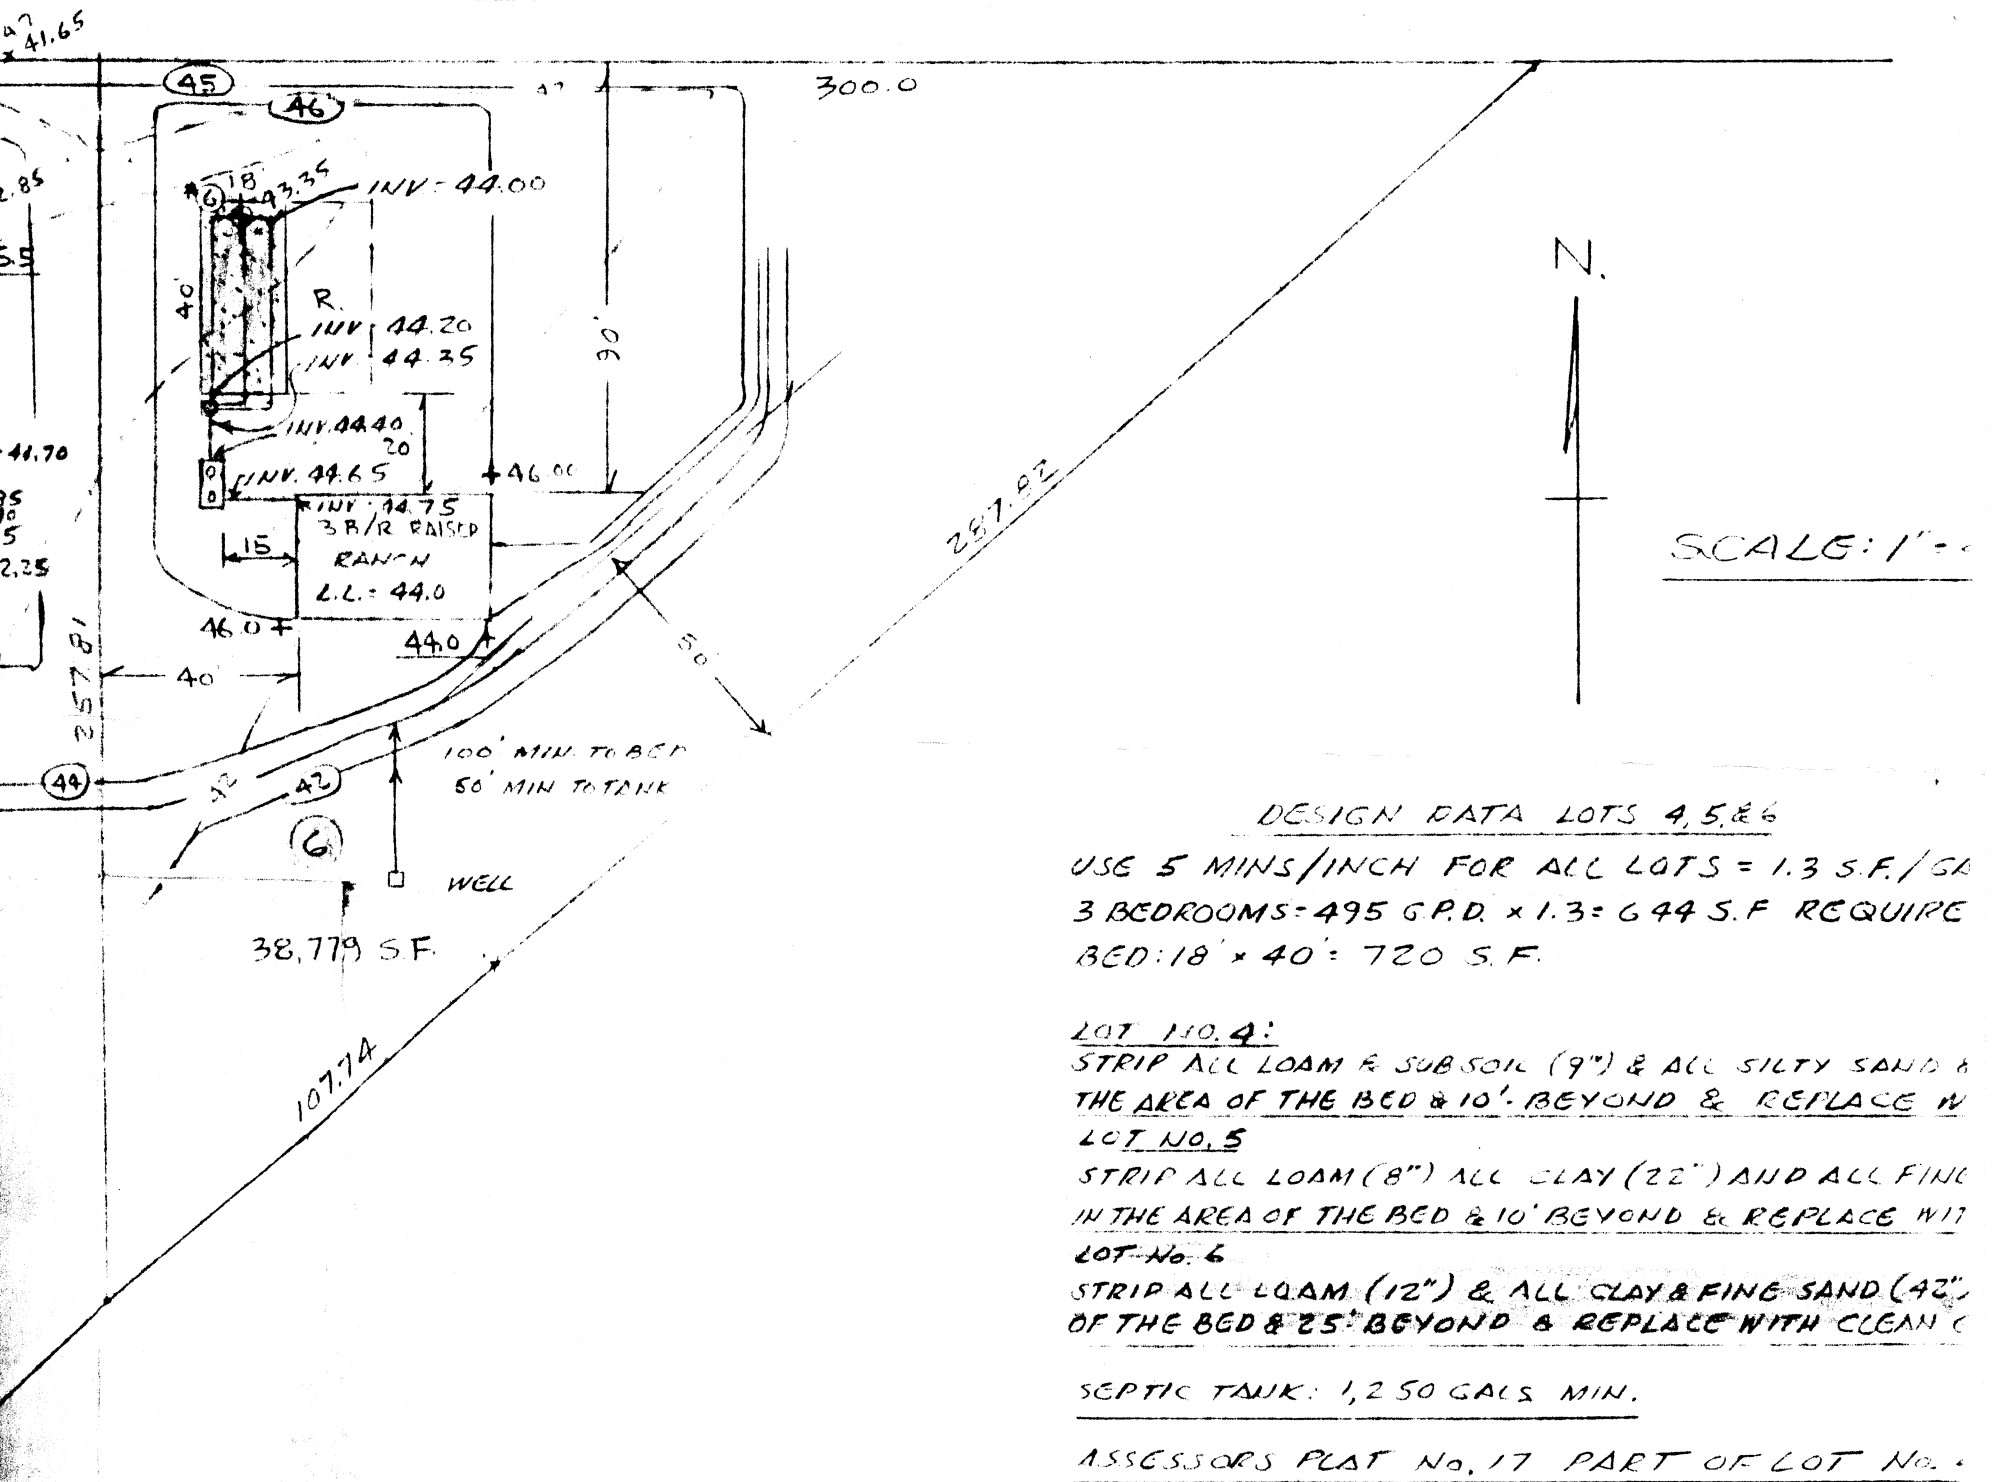

DESIGN DATA LOTS 4, 5, & 6

USE 5 MINS/INCH FOR ALL LOTS = 1.3 S.F./GAL  
 3 BEDROOMS = 495 G.P.D. x 1.3 = 644 S.F. REQUIRE  
 BED: 18' x 40' = 720 S.F.


LOT NO. 4:  
 STRIP ALL LOAM & SUBSOIL (9") & ALL SILTY SAND &  
 THE AREA OF THE BED & 10' BEYOND & REPLACE W/  
LOT NO. 5

STRIP ALL LOAM (8") ALL CLAY (22") AND ALL FINE  
 IN THE AREA OF THE BED & 10' BEYOND & REPLACE W/  
LOT NO. 6

STRIP ALL LOAM (12") & ALL CLAY & FINE SAND (42")  
 OF THE BED & 25' BEYOND & REPLACE WITH CLEAN C

SEPTIC TANK: 1,250 GALS MIN.

ASSESSORS PLAT No. 17 PART OF LOT No. 4

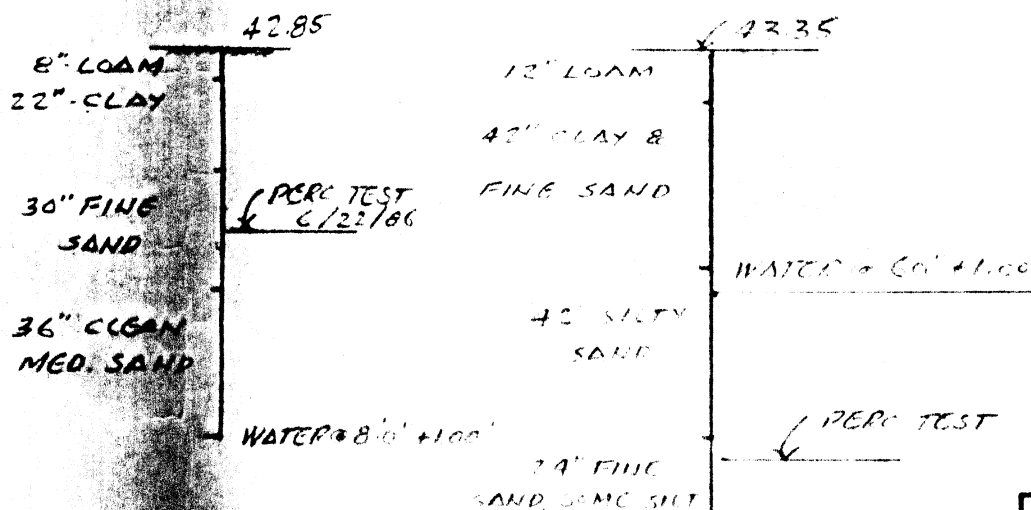

TEST 22/86

20'0" +1.00'

(LOT No. 4)

DEPTH

TEST PIT (LOT No. 5)

2 MIN/INCH @ 45" DEPTH

4/15/86

43.35

5.00

38.35

TEST PIT (LOT No. 6)

5 MINS/INCH @ 100" DEPTH

4/15/86

43.35

5.00

38.35

**APPROVED**

Manuel G. M.

July 8

