

SEWAGE DISPOSAL PLAN
LOT 11


BROOK HILL ACRES

SEEKONK, MA

OCTOBER, 1984

SCALE 1"=30'

A= 21.689

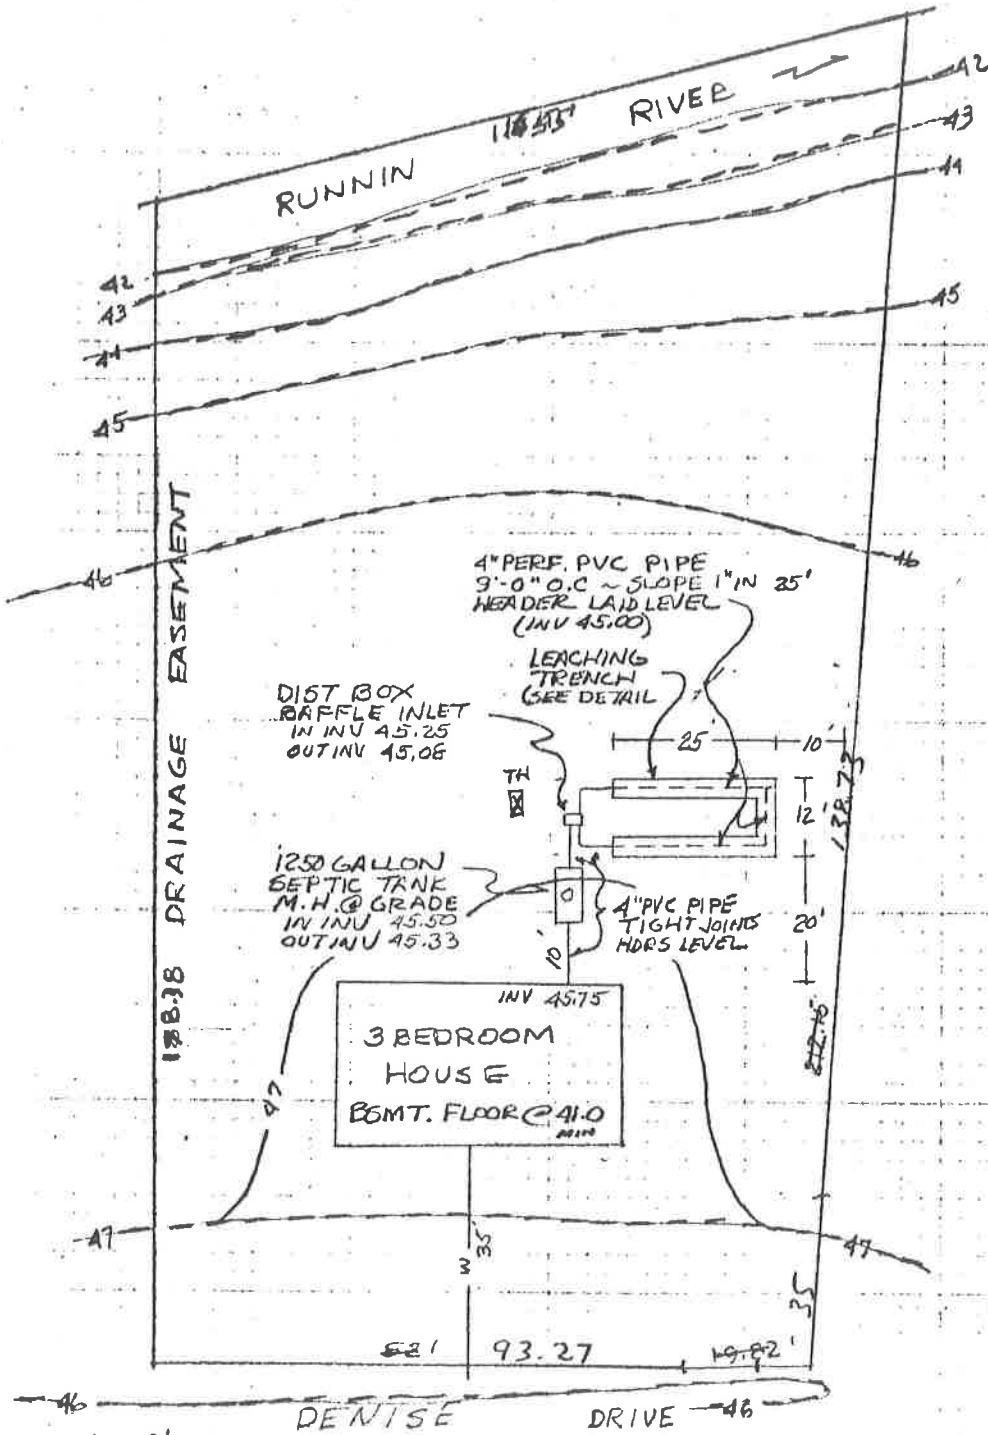

SOIL PROFILE
IN TEST HOLE

TOP SOIL	21"	46.5
PACKED SILTY SAND & GRAVEL	45"	
GRAY M-C SAND	48"	

WATER @ 92"

PERC RATE = 4 MPI @ 72"

WITNESSED BY J. BRESCIA
4-30-77

--- PRESENT CONTOURS
— PROPOSED CONTOURS

B.M. INV 4'x8' RUNNIN RIVER
CULVERT @ PLEASANT ST
EL 40.78




NOTES

REMOVE ALL TOP SOIL AND PACKED SILTY SAND & GRAVEL (~5.5' DEEP) FROM LEACHING AREA AND FOR 10 FT ON ALL SIDES

BACKFILL WITH CLEAN, COARSE SAND OR GRAVEL TO EL 45.3'

CONSTRUCT LEACHING TRENCHES IN THIS FILL

MAINTAIN MINIMUM FINISH GRADE OF 45.0 FOR 25 FT ON ALL SIDES OF LEACHING TRENCHES

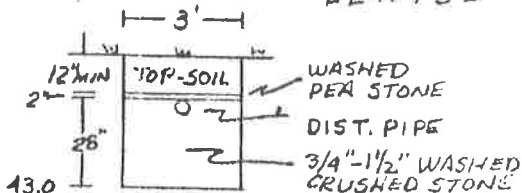

LEACHING TRENCH
TYPICAL SECTION

AREA BETWEEN LEACHING TRENCHES RESERVED FOR FUTURE LEACHING AREA

MINIMUM FINISH SLOPE OVER LEACHING AREA ~ 2%

Robert H. Hawley
R. H. HAWLEY
ENGINEERING CORP
SWANSEA, MA