



JUDYANN

*61.40

DR.

PLAN



SCALE: 1" = 20'

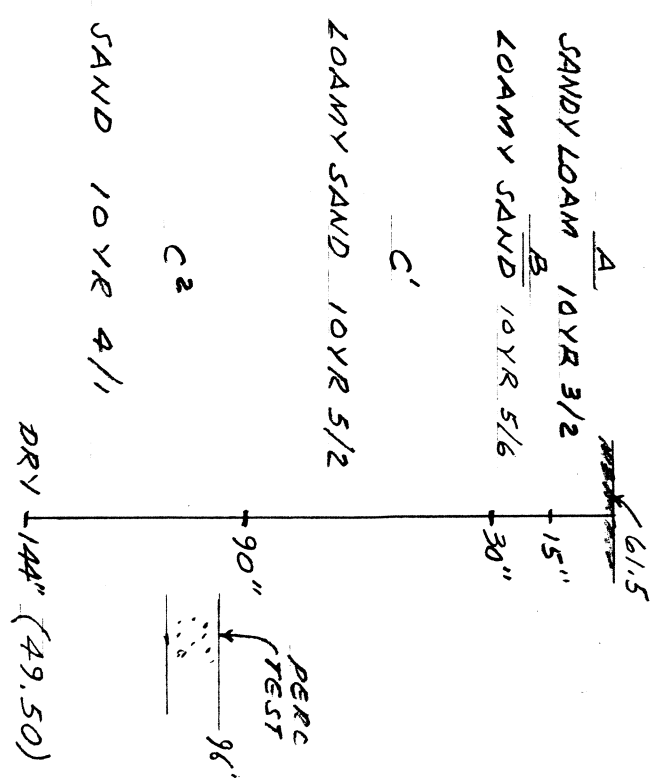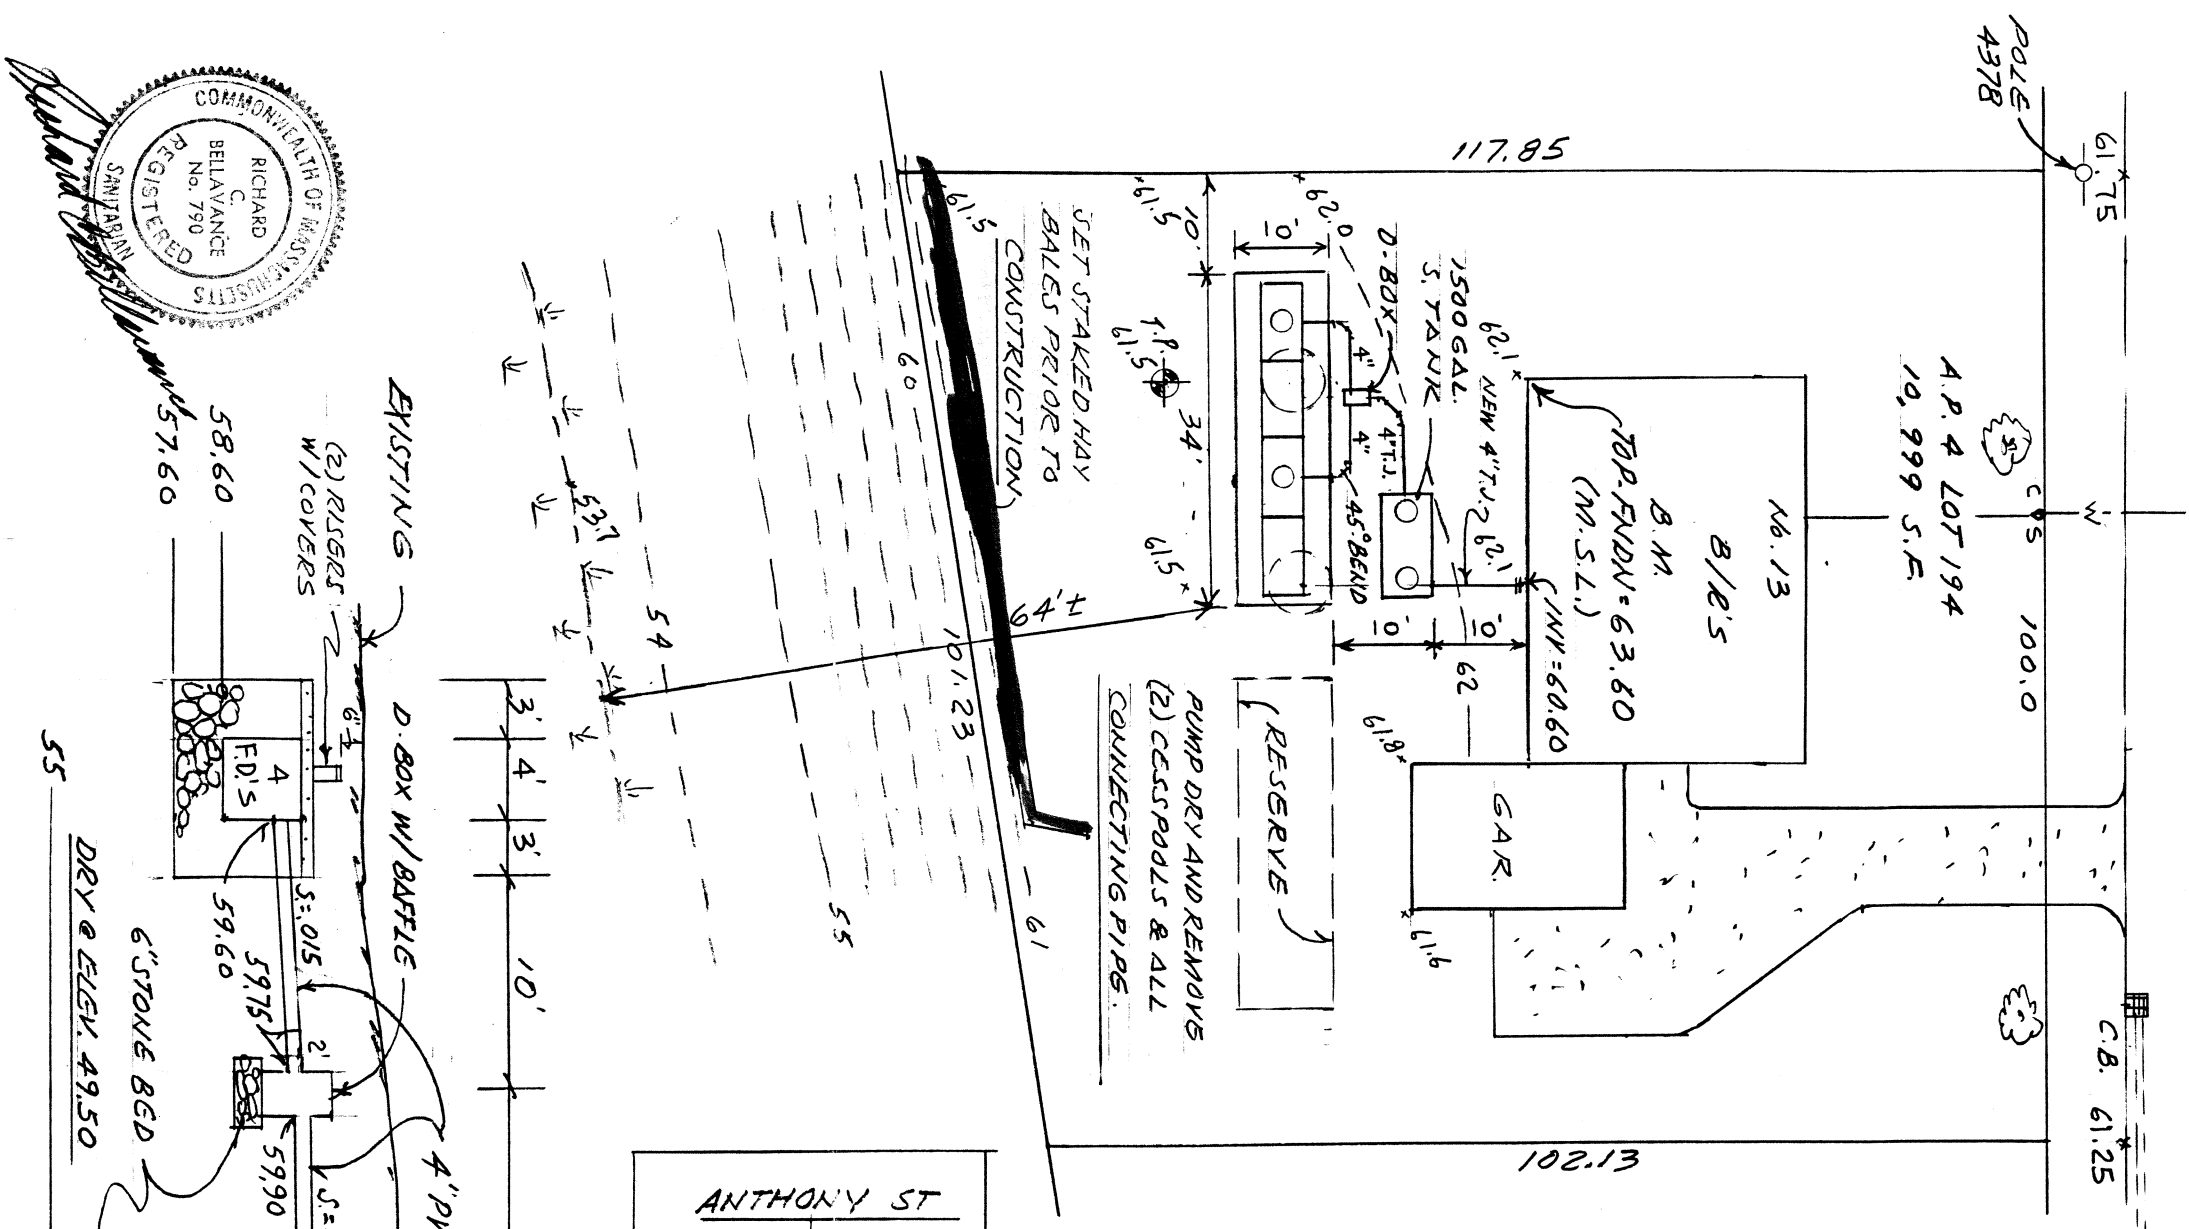


TEST PIT 4/15/97
 PERC RATE: LESS THAN 2 MINS/INCH
 DRY 1/4\"/>

DESIGN DATA
 3 B/R'S = 330 GPD. USE (4) FLOWDIFFUSORS
 4'x8' WITH 12\"/>


TOTAL = 476 S.F.
 476 S.F. x 0.74 GAL/S.F. = 352 GAL/S

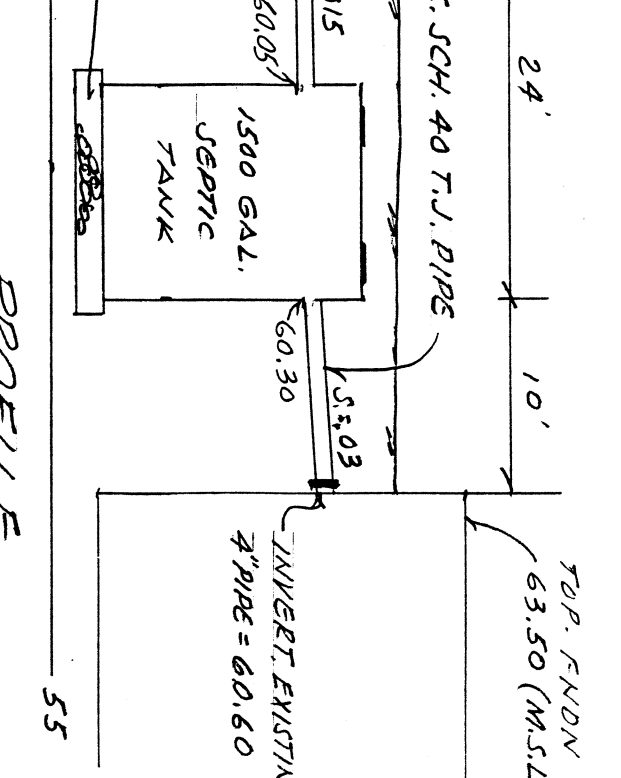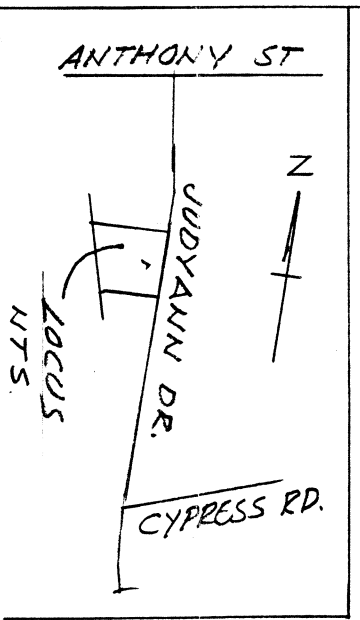

PROFILE
 SCALE: HOR: 1" = 10'
 VERT: 1" = 4'

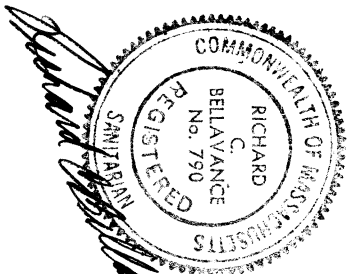

PRECAST LEACHING CHAMBER FD 4 X 8 - D FLOWDIFFUSOR®
 (2) FD 4X8-D & (2) FD 4X8-L REQUIRED

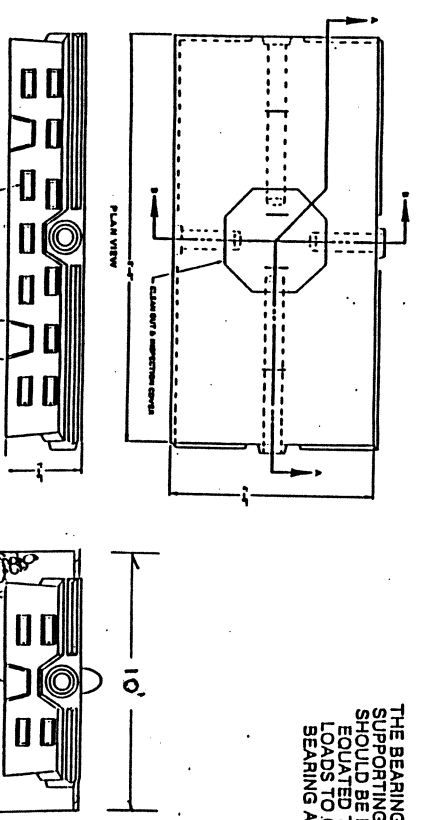

THE BEARING POWERS OF SOIL SUPPORTING ANY STRUCTURE SHOULD BE DETERMINED AND EQUATED TO THE APPLIED LOADS TO CALCULATE THE BEARING AREA REQUIRED.

REMOVE ALL SOILED & UNSUITABLE MATERIAL (90\"/>

SHEET No. 1 OF 1

SEWAGE DISPOSAL REPAIR
 PLAT 4 LOT 194 ZONING R/1
 No. 13 JUDYANN DRIVES